

Installation diagram for connection of Fire Halo to charged 90/100mm PVC feeder pipe

- Please note that PVC primer and PVC cement is recommended to join Fire Halo to PVC downpipes.

A – Main (Large) Ball Valve


B – Bottom (Small) Ball Valve

C – Hose

D – End Cap

E – Top Downpipe (tank)

F – Bottom Downpipe (gutters)

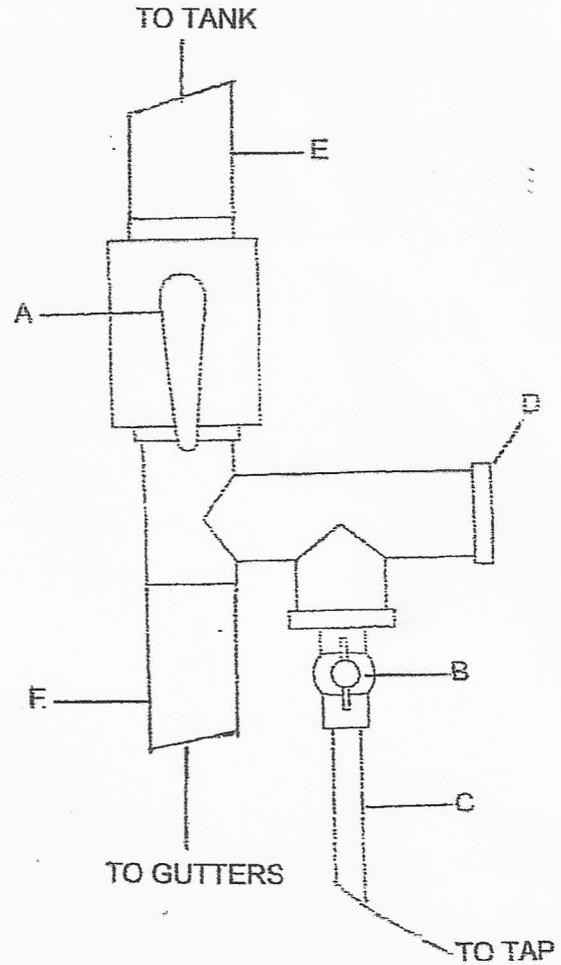

Box Includes:

1 x Fire Halo

1 x Hose Attachment

2 x 100mm/90mm reducers



firehalo.com.au